



HYDRANTS

MILD CLIMATE ANTI-SIPHON SILLCOCK

FUNCTION: For installation in interior and exterior wall locations of buildings that are not subject to freezing. Vacuum breaker prevents contamination of potable water supply and conforms to the requirements of ASSE Standard 1011.

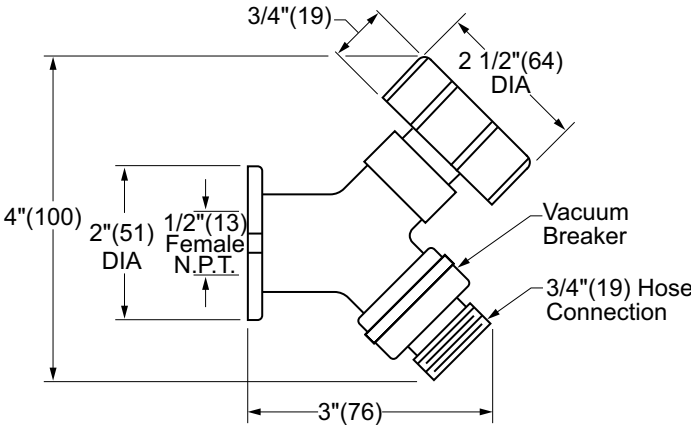


Fig. M-36721/2"(13) Inlet

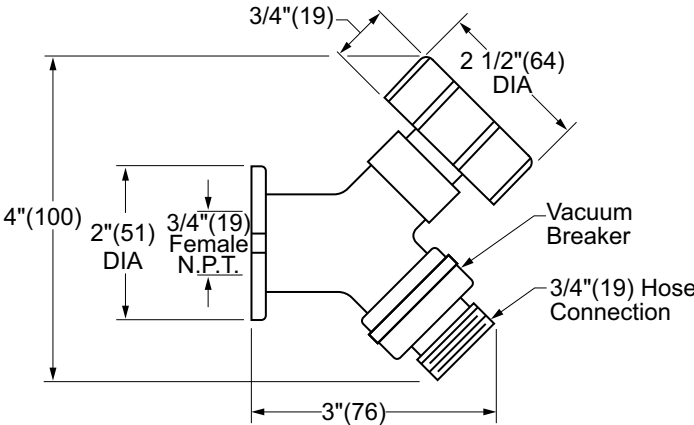


Fig. M-36733/4"(19) Inlet

NOTES:

1. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water Components are not applicable to hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
2. Dimensions shown in parentheses are in millimeters.
3. **FOR IRRIGATION PURPOSES ONLY.**

REGULARLY FURNISHED:

Hose Valve has a Rough Finish Brass Body Removable Wheel Handle, "T" Handle Key, NPT Female Threaded Inlet Size Indicated by Figure Number Selected and ASSE 1011 Vacuum Breaker with 3/4"(19) Hose Connection.

OPTIONAL MATERIALS:

Rough Chrome Plated -CR

⚠ WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov

Murdock Mfg.™ warrants that its products are free from defects in material or workmanship under normal use and service for a period of one year from date of shipment. Murdock's liability under this warranty shall be discharged solely by replacement or repair of defective material, provided Murdock™ is notified in writing within one year from date of shipment, F.O.B. Industry, California.

SELECTION SUMMARY & APPROVAL FOR MANUFACTURING	Model Number & Options _____	Quantity _____	All dimensions are subject to manufactures tolerance of plus or minus 1/2" nominal and subject to change without notice. Murdock assumes no responsibility for use of void or superseded data. Dimensions may change with the addition of optional accessories. Murdock Mfg.™, Member of Morris Group International™. Please visit www.murdockmfg.com for most current specifications.
	Company _____		
	Contact _____	Title _____	
	Signature (Approval for Manufacturing) _____	Date _____	